



SIDEWALK TYPE 1

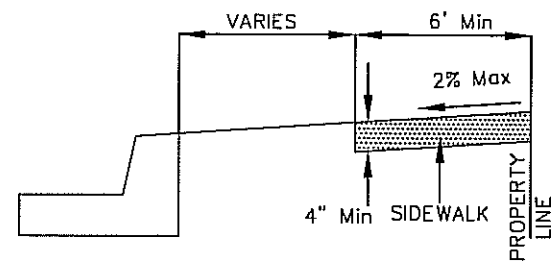

SIDEWALK TYPE 2

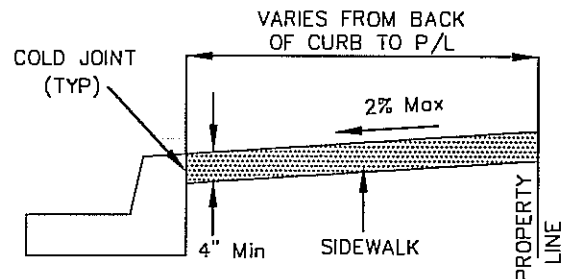

SIDEWALK TYPE 3

GENERAL NOTES:

1. SUBGRADE PREPARATION SHALL BE CONSTRUCTED TRUE TO GRADE AND CROSS SECTION, WITH COMPACTION OF 95% TO A DEPTH OF 1.0 FEET.
2. MINIMUM GRADE FOR CURB AND GUTTER SHALL BE 0.2%. EXCEPTIONS TO THE MINIMUM GRADE SHALL BE APPROVED BY THE TOWN ENGINEER.
3. CONCRETE SURFACE SHALL BE FINISHED TO GRADE AND CROSS SECTION WITH A FLOAT, TROWELED SMOOTH, AND FINISHED WITH A BROOM.
4. EXPANSION JOINT FILLER MATERIAL SHALL CONSIST OF PREFORMED STRIPS OF A DURABLE, RESILIENT COMPOUND.
5. SIDEWALK SCORE MARKS MINIMUM DEPTH OF 0.125".
6. ROLL-TOP CURB & GUTTER ONLY ALLOWED IN INDUSTRIAL ZONES WITH APPROVAL OF THE TOWN ENGINEER.
7. SIDEWALK TO CURB AND GUTTER NOT TO BE POURED AS MONOLITHIC.
8. PROPERTY AT INTERSECTIONS SHALL BE A 20 FOOT BY 20 FOOT CUT OFF FOR WHEELCHAIR RAMPS.
9. SIDEWALK SHALL BE CONSTRUCTED OF CLASS "B" CONCRETE.

R = 25' FOR RESIDENTIAL CURB RETURNS
 R = 35' FOR COMMERCIAL/INDUSTRIAL CURB RETURNS

APPROVED BY:

 ARTUR DA ROSA
 TOWN ENGINEER
 1-26-2009
 DATE

STANDARD DRAWING
 SIDEWALK

The Town of
YUCCA VALLEY
 No. **220**