


24" DIA. MANHOLE FRAME AND GRATE
ALHAMBRA # A-1200 OR APPROVED
EQUAL.


1" DIA. HOLE W/ MIRAFI
FABRIC BACKING
AS SHOWN

CAP DETAIL

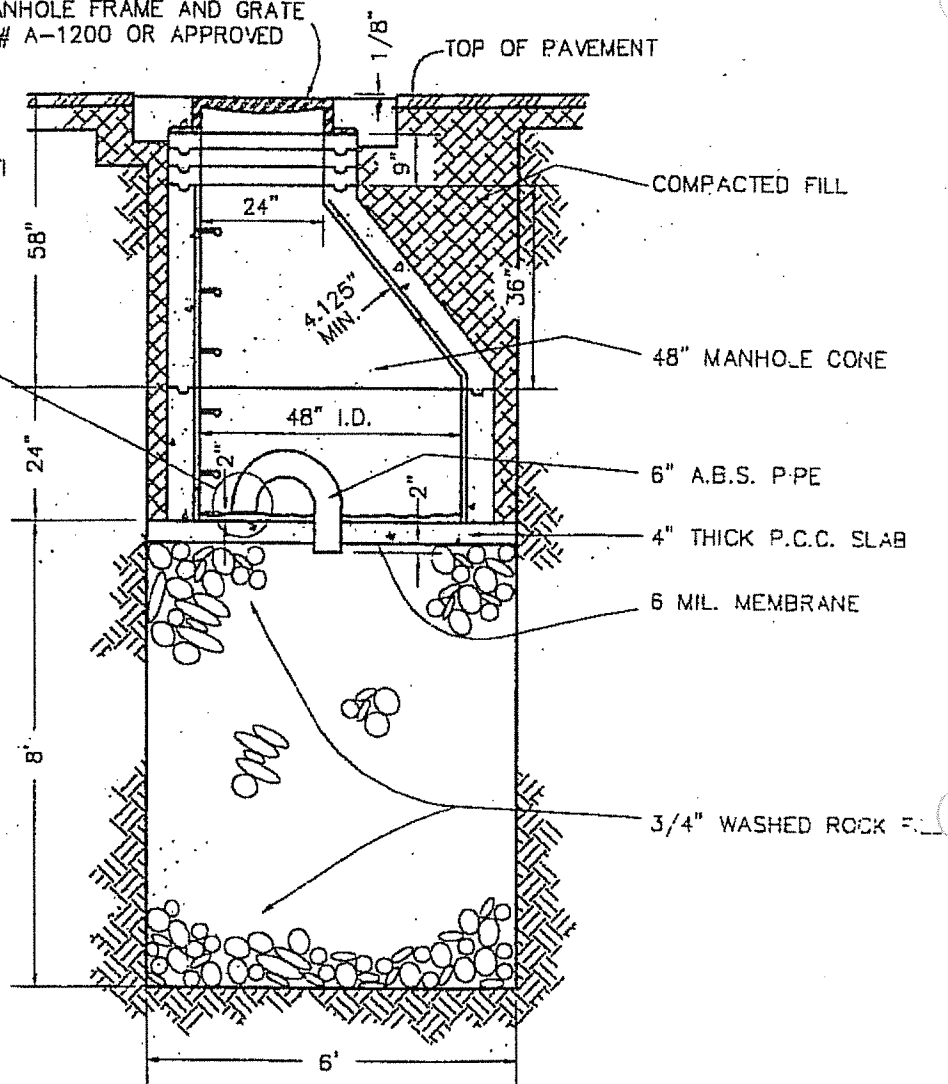

NOTES:

1. PRECAST REINFORCED CONCRETE MANHOLE PIPE TO MEET REQUIREMENTS OF ASTM C 478 SPECIFICATIONS WITH INCREASES IN REINFORCEMENT AND WALL THICKNESS TO MEET LOCAL REQUIREMENTS. MINIMUM COMPRESSIVE STRENGTH OF CONCRETE SHALL BE 4000 P.S.I. AT 28 DAYS.
2. DRYWELL DIMENSIONS AND LOCATION SHALL BE VERIFIED BY A LICENSED SOILS ENGINEER.
3. FINAL DESIGN IS SUBJECT TO APPROVAL BY THE TOWN ENGINEER.



APPROVED:

DATE

APPROVED: TOWN ENGINEER

Robert K. Holt

R.C.E. 27943



Town of
Yucca Valley

STANDARD DRY WELL

STANDARD DRAWING NO. 463

REVISION

BY DATE